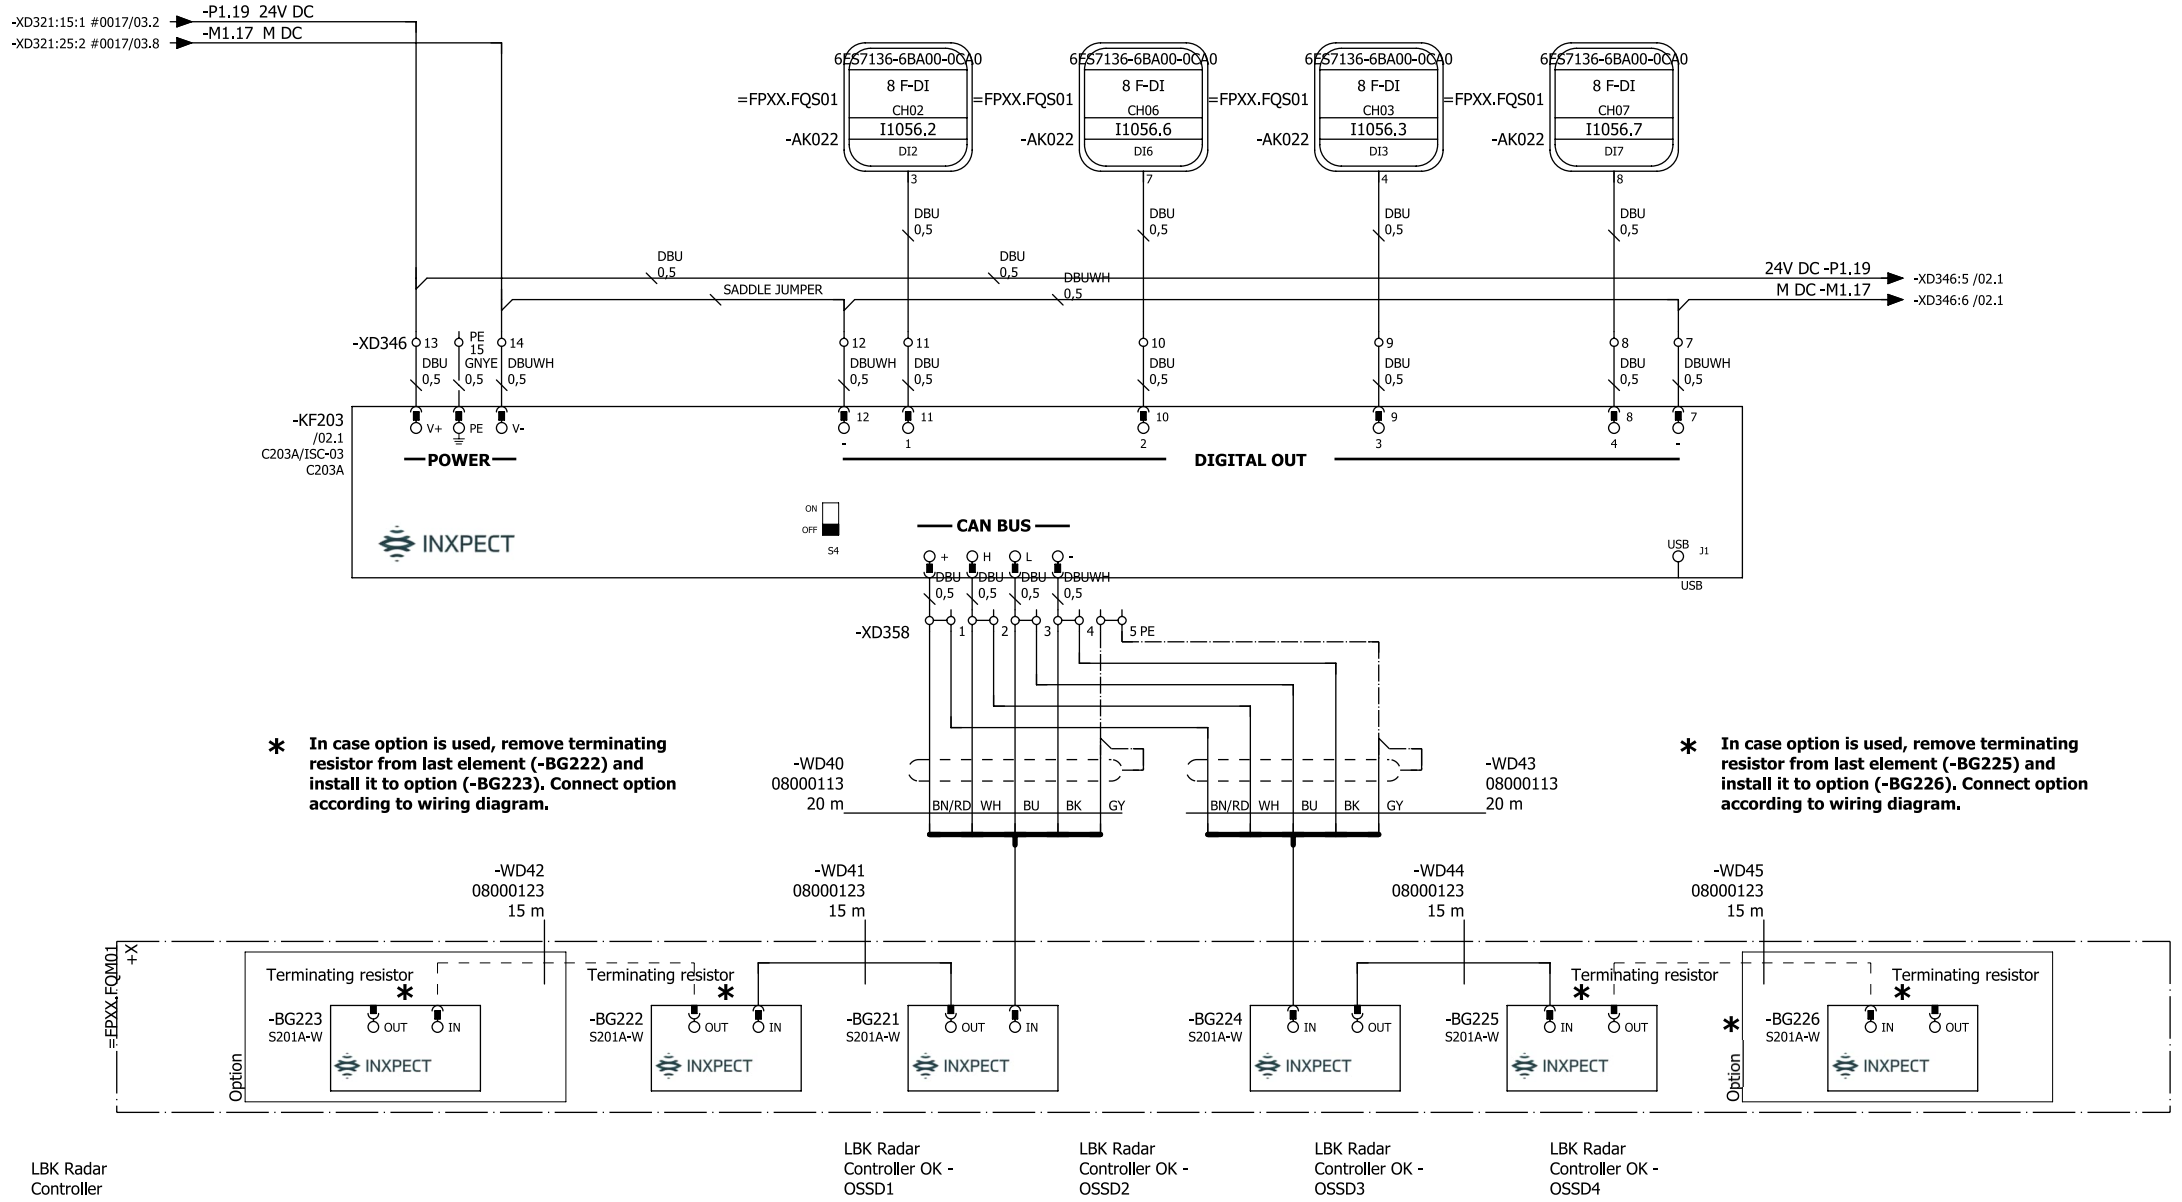

* **In case option is used, remove terminating resistor from last element (-BG222) and install it to option (-BG223). Connect option according to wiring diagram.**

* **In case option is used, remove terminating resistor from last element (-BG225) and install it to option (-BG226). Connect option according to wiring diagram.**

#6040/11

02

Datum	2025.07.24	PAS (Personal Access System) Control Cabinets	GSI FAIR	Radar system LBK Radar Controller	Zeichnungsnummer	== AF200	DCC &EFS ++
Bearb.	T.Riedel					= FPXX.FQS01	+ UH011
Gepr.	GSI: C. Betz / M. Salinas				Projekt-Nr.	Blatt 320 von 1944	Struktur 6050
Norm	GSI/FAIR						Blatt 01 von 2

Projektpfad: \\campus\groups\ga\EPLAN\Projekte\ACO\IND_PAS\FAIR\EPLAN
Epl. Projekt: GSI_FAIR_Personnel Access System_V2024_20250916
CAE-Eplan P8: 2024.0.3
Plott: 2025.07.24
Veröffentlichung, Vervielfältigung und Weitergabe (auch auszugsweise) nur mit ausdrücklicher genehmigung durch GSI Helmholtzzentrum für Schwerionenforschung GmbH D-64291 Darmstadt
GSI_GAT_FN1